



Industrie Service

Mehr Sicherheit.
Mehr Wert.

Technical Report

IS-DDB-MAN-10-097

**Fire-Safe-Test according to DIN EN ISO 10497, 11.2004
resp. API 607, fifth edition, 06.2005
at 1 gasket of the type "KLINGERSIL C-4439"**

Datum: 28.06.2010

Unsere Zeichen:
IS-DDB-MAN/Jo
Dokument: PB Fire-Safe_klinger-
Austria_DIN_EN_ISO_10497-
Dichtung-Klingersil-C4439-10-
E.docx

Das Dokument besteht aus
5 Seiten.
Seite 1 von 5

Die auszugsweise Wiedergabe des
Dokumentes und die Verwendung
zu Werbezwecken bedürfen der
schriftlichen Genehmigung der
TÜV SÜD Industrie Service GmbH.

Die Prüfergebnisse beziehen
sich ausschließlich auf die
untersuchten Prüfgegenstände.

Applicant: Rich. Klinger Dichtungstechnik GmbH & Co.KG
Am Kanal 8-10

A – 2352 Gumpoldskirchen

Issued on: 2010-06-28 in 2 Copies each 5 pages and 2 Attachements

Issuer: Dipl.-Ing. John



Sitz: München
Amtsgericht München HRB 96 869
UST-IdNr. DE129484218
Informationen gemäß § 2 Abs. 1 DL-InfoV
unter www.tuev-sued.de/impressum

Aufsichtsrat:
Peter Kardiell (Stellv. Vorsitzender)
Geschäftsführer:
Ferdinand Neuwieser (Sprecher),
Dr. Ulrich Klotz, Thomas Kainz

Telefon: +49 621 395-0
Telefax: +49 621 395-594
www.tuev-sued.de/is

TUV®

TÜV SÜD Industrie Service GmbH
Region Baden-Württemberg
Abteilung Druckbehälteranlagen
Dudenstraße 28
68167 Mannheim
Deutschland



1. Order

Company Rich. Klinger Dichtungstechnik GmbH & Co.KG applied at TÜV SÜD Industrie Service GmbH the accomplishment of a Fire-Safe-Test according to DIN EN ISO 10497 resp. API 607, fifth edition at 1 gasket of the type „KLINGERSIL C-4439“, which was flanged to a ball valve with a nominal size of DN 50, PN 40.

The test was done on the 23.06.2010 in Graben-Neudorf with presence of an authorised expert of TÜV SÜD Industrie Service GmbH.

2. Accomplishment of the test

The test assembly and the accomplishment was carried out in accordance with DIN EN ISO 10497 (see installation scheme).

3. Test result

The test results mentioned in the attachment show that the requirements according DIN EN ISO 10497 resp. API 607, fifth edition have been achieved by the gasket

KLINGERSIL C-4439, DN 50, nominal pressure PN 40, thickness 1,5 mm, see data sheet in the attachment

in combination with a ball valve INTEC 112-FS.

The gasket was tightened with a torque of 150 Nm which is equal to a surface pressure of 38 N/mm².

4. Area of application

According to the testing of a gasket DN 50 simultaneously the requirements for gaskets of the same type are valid for nominal size DN 50 and below, DN 65, DN 80 and DN 100.

According to the testing of the gasket for a nominal pressure PN 40, gaskets of the same type for nominal pressures PN 40, PN 63 and PN 100 are also covered.



Test protocol

1. **Date of the test** June, 23., 2010

2. **Location of the test** KLINGER SCHÖNEBERG GmbH
Heidelberger Straße 3
76676 Graben-Neudorf

3. **Test specifications** DIN EN ISO 10497, 11.2004 resp. API 607, fifth edition, 6.2005

4. **Gasket manufacturer** Rich. Klinger Dichtungstechnik GmbH & Co. KG
Am Kanal 8-10
A – 2352 Gumpoldskirchen

5. **Tested gasket (in combination with 1 ball valve)**

Gasket KLINGERSIL C-4439; DN50, PN40
Thickness 1,5 mm; Torque 150 Nm;
Surface pressure 38 N/mm²
Limits of use: see data sheet as attachment

6. **Test ball valve** INTEC 112-FS, DN50, PN40
Material valve body/flange: 1.0619

7. **Test conditions**

Test fluid: Water

Test fuel: Liquid gas acc. DIN 51622

Burn period: 30 minutes

Thermocouples: The temperature of the flames after 2 minutes should be 750 °C; the average temperature at the flame area should be between 750 °C and 1000 °C and should not fall below 700 °C.

Calorimeter cubes: The average temperature after 15 minutes should be 650 °C. This temperature should be held during the burn period and should not fall below 560 °C.

Test pressure:
(Low-pressure) 2 bar
(High-pressure) 30 bar



Industrie Service

8. Test procedure

8.1 Preliminary test: Tightness test of the valve with water (1,4 x PN)

Test pressure: 56 bar

Result: Ball valve was tight

8.2 Burn period

Temperatures of the Calorimetercubes

Temperature after 15 min		Average temperature after 15 min till end of the burn period	
		K1	K2
Ball valve	Temperature 667 °C	660 °C	677 °C

Temperatures of the thermocouples

Temperature after 2 min		Average temperature	
		T1	T2
Ball valve	Temperature 1024 °C	977 °C	940 °C

8.3 Cooling-down period of the ball valve to 100°C

Ball valve 5 Min

8.4 Through-seat leakage during burn period

max. permissible Leakage during the burn period: 200 ml/min

determined leakage: Ball valve 194 ml

Result: passed

8.5 Closing of the fuel supply and cooling down to 100 °C

Cooling down with air blast cooling and water.

8.6 External leakage during the burn period and the cooling-down period

max. permissible leakage during the burn period and cooling down period: 50 ml/min

determined leakage: Ball valve 0 ml

Result: passed



Industrie Service

8.7 For valves PN 100 and below the test pressure should be held constant at 2 bar and the leakage through the seat should be measured over a period of 5 minutes.

8.8 Through-seat Leakage after cooling-down

max. permissible leakage: 80 ml/min

determined leakage: Ball valve: 0 ml

Result: passed

8.9 Operability

Increase the test pressure to high pressure, close the shut-off valve (Nr. 15) and open the ball valve against the upcoming pressure.

Holding of the high test pressure and measuring of the outer leakage over a period of 5 minutes.

8.10 External leakage following operational test

max. permissible Leakage: 50 ml/min

determined Leakage: Ball valve: 0 ml

Result: passed

8.11 Optical appearance of the gasket after completion of the Fire-Safe-test


The gasket was in one piece and slightly stuck on the flange.

Mannheim, 28th June, 2010
IS-DDB-MAN/jo


TÜV SÜD Industrie Service GmbH
Abteilung Druckbehälter
The expert


Dipl.-Ing. John

Attachments: Installation scheme of the test rig
Data sheet



Maße in Millimeter

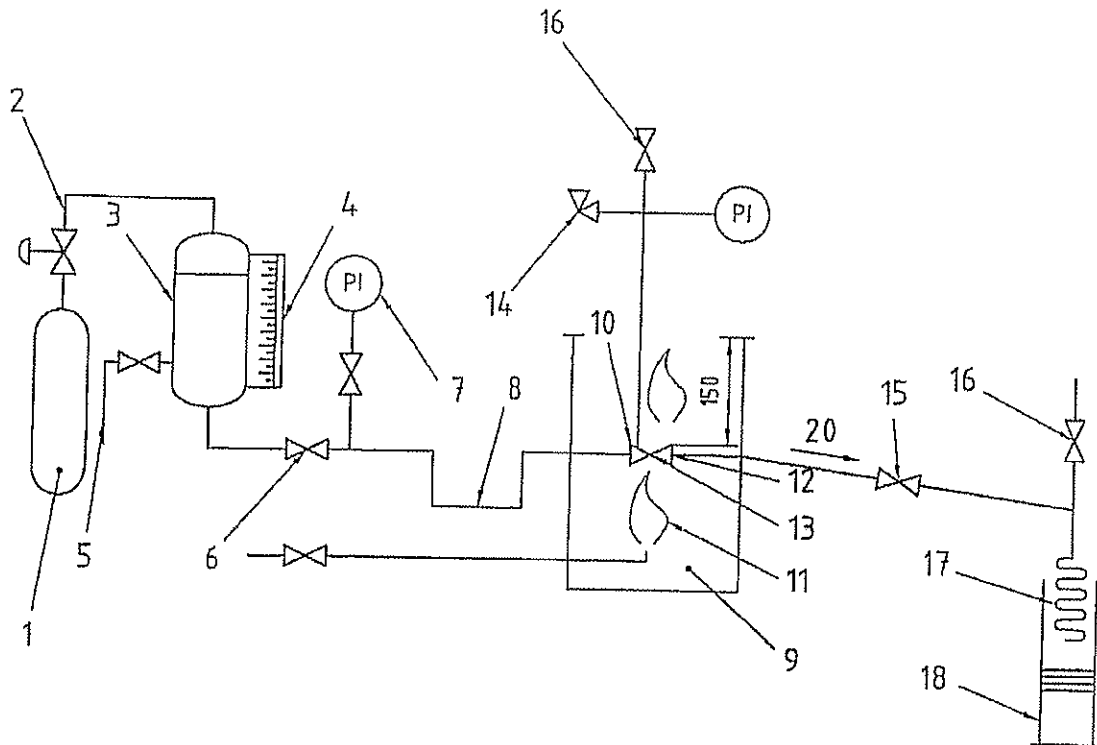


b) Druckgas als Druckerzeuger

Legende

- | | |
|--|--|
| 1 Druckerzeuger | 12 Kalorimeter-Würfel (siehe 5.3.2) |
| 2 Druckregel- und -entlastungseinrichtung | 13 Thermopaare, flammene geeignet, und Thermopaare für Gehäuse (siehe 5.3.2) |
| 3 Wasserbehälter | 14 Druckmessgerät und Druckentlastungsarmatur (siehe 5.3.2) |
| 4 Kalibrierter Sichtmessstab | 15 Absperrarmatur |
| 5 Wasserzuleitung | 16 Entlüftungsarmatur |
| 6 Absperrarmatur | 17 Kondensator |
| 7 Druckmessgerät | 18 Behälter (siehe 5.3.2) |
| 8 Rohrleitung, die so angeordnet ist, dass eine Dampfsperre entsteht (siehe 5.3.2) | 19 Rückflussverhinderer |
| 9 Gehäuse für die Prüfung | 20 Neigung |
| 10 Prüfarmatur, horizontal eingebaut, Spindel in horizontaler Lage (siehe 5.6.1) | 21 Lichter Abstand 150 mm |
| 11 Brenngaszufuhr und Brenner | |

Bild 1 — Empfohlenes System (fortgesetzt)

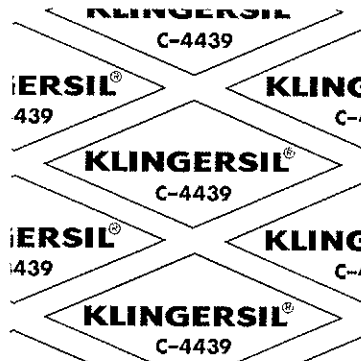
Typical values for 2 mm thickness

Compressibility ASTM F 36 J		%	6
Recovery ASTM F 36 J	min	%	55
Stress relaxation DIN 52913	50 MPa, 16 h/300°C	MPa	35
Klinger cold/hot compression, 50 MPa	thickness decrease at 23°C	%	7
	thickness decrease at 300°C	%	6
Thickness increase ASTM F 146	oil IRM 903: 5 h/150°C	%	5
	fuel B: 5 h/23°C	%	8
Density		g/cm ³	2.1

Important points to be observed

The selection of gaskets requires expertise and know-how since ever greater reliability coupled with the lowest possible leakage rates are demanded of gasket materials.

The exacting demands made on the tightness of gasket materials (e.g. Tightness class L_{0,01}) mean that with increasing internal pressure higher surface pressures must be applied to the gasket.

It must be shown that the flange joint will tolerate the demands made on it without being mechanically overloaded. Furthermore, the surface pressure applied to create the seal should never fall below the required minimum value since this will reduce the life of the gasket. Highly stressed, but not overstressed gaskets have a longer service life than understressed gaskets.

If the gasket fitted will be subjected to non-static loading, or will suffer stress fluctuations during discontinuous operation, it is advisable to choose a gasket which is not prone to embrittlement with increasing temperature (e.g. KLINGERgraphite laminate, KLINGERtop-chem, KLINGERtop-sil or KLINGER® Quantum), especially for steam and/or water applications.



For discontinuous operation in water and/or steam applications, we recommend as a general guide a surface pressure of 30 MPa at least. In such cases the gasket should be as thin as technical possible.

For reasons of safety, we do not recommend the re-use of gaskets.

Due to the metal reinforcement the already good stress relaxation is improved and a high strength against mechanical loads in the flange connection (elongation because of temperature changes) is achieved.

Dimensions of the standard sheets

Sizes:
1,000 x 1,500 mm, 2,000 x 1,500 mm.
Thicknesses:
1.0 mm, 1.5 mm, 2.0 mm, 3.0 mm;
other thicknesses on request.
Tolerances:
thickness ± 10%, length ± 50 mm,
width ± 50 mm



Powerful sealing calculation
with online help on CD-ROM

Surfaces

The standard surface finish of the material is such that the surface has an extremely low adhesion. On request, graphite facings and other surface finishes on one or both sides are also available.

Function and durability

The performance and life of KLINGER gaskets depend in large measure on proper storage and fitting, factors beyond the manufacturer's control. We can, however, vouch for the excellent quality of our products.

With this in mind, please also observe our installation instructions.

Subject to technical alterations.
Status: June 2010

**Certified according to
DIN EN ISO 9001:2000**

Rich. Klinger Dichtungstechnik
GmbH & Co KG
Am Kanal 8-10
A-2352 Gumpoldskirchen, Austria
Tel ++43 (0) 2252/62599-137
Fax ++43 (0) 2252/62599-296
e-mail: marketing@klinger.co.at
<http://www.klinger.co.at>